


GENERAL NOTES:
1. TERMINATE PLUMBING VENTS ON ROOF AT MINIMUM 10 FEET FROM ANY OSA INTAKES. CONTRACTOR TO COORDINATE LOCATION WITH EXISTING ROOF HVAC EQUIPMENTS.

SERVICE WATER COMMISSIONING AND COMPLETION REQUIREMENTS:
SERVICE WATER SYSTEMS MUST MEET THE SERVICE WATER SYSTEM COMMISSIONING AND COMPLETION REQUIREMENTS PER WASHINGTON ENERGY STATE ENERGY CODE, CHAPTER 4, INCLUDING THE REQUIREMENTS FOR PROJECT COMMISSIONING STATED IN SECTION C408 & COMPLETION OF A COMMISSIONING REPORT, AND THE CHECKLIST SHOWN IN FIGURE C408.1.2.1
SEE SPECIFICATION 230500, 230590, 230993, 230923 FOR FURTHER DETAILS.

TOTAL DEVELOPED PIPE LENGTH = 70'
TOTAL LOAD = 120 MBH
LOW PRESSURE @ 0.3" W.C. P.D.
MIN. PIPE SIZE = 1"

1 PLUMBING PLAN
P2.1 SCALE: 1/4" = 1'-0"

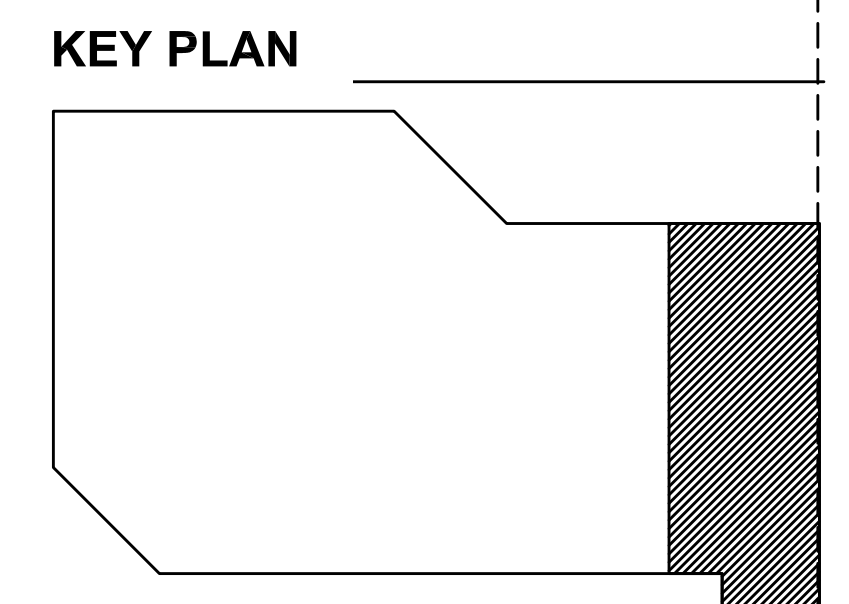

MultiCare **LAKEWOOD OCCUPATIONAL MEDICINE**
Clinics
BetterConnected
Lakewood, Washington

5700 100th Street SW, Suite 510, Lakewood, Washington 98499

ISSUE DATE: 12.17.15
REVISIONS:

PLUMBING PLAN

P2.1

PERMIT SET